


42' Steel Arch Frame

DESIGN ENGINEER:

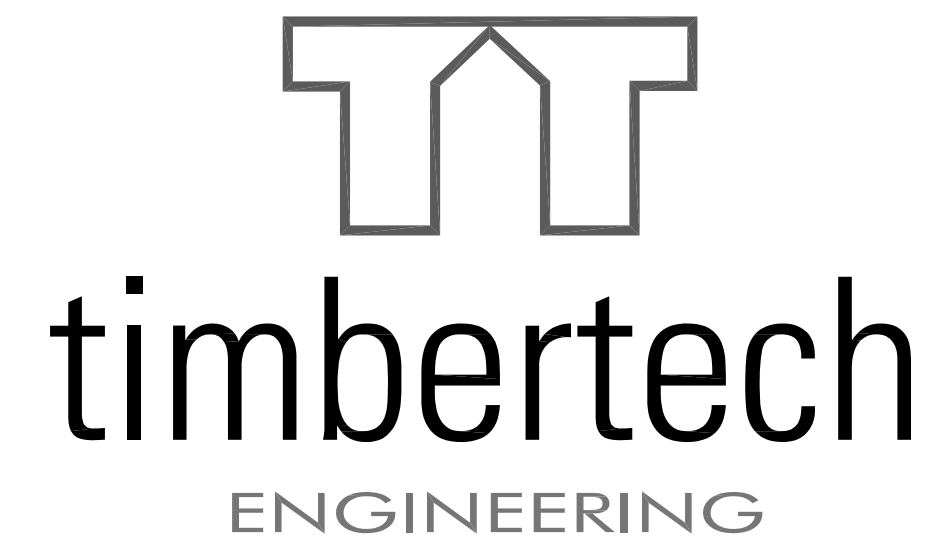

206 S. Main Street, P.O. Box 509 Kouts, IN 46347
219.766.2499 Fax: 219.766.2394

CONTRACTOR / BUILDER:

Yoder Way
191 Buttonwood Road
Newport, PA 17074
Ph: 717.535.5883
Fax: 717.535.4491

DRAWING INDEX:

COVER PAGE - Project description & notes
PAGE 1 - Bracing Plans, Cross Sections, Details
PAGE 2 - Details

Note:

This plan is intended to reflect only the structural design of this building. The contractor shall review all local, state, and federal building codes prior to the start of construction to insure building conformance.

GENERAL NOTES

All notes do not necessarily apply due to different requirements on each project. This plan is intended to reflect only the structural design of this building. The contractor shall review all applicable local, state, and federal building codes prior to the start of construction to ensure building conformance. Timber Tech Engineering, Inc. is not responsible for information pertaining to this project if not shown on drawings or listed below. Revisions to the plans shall be approved by engineer of record.

DESIGN REQUIREMENTS

1. Governing Code: ASCE 7-02 (Agricultural Use, Low Occupancy)	
2. Dead Loads:	
A. Roof	5 psf
B. Floor	n/a psf
C. Other	n/a psf
3. Live Loads:	
A. Roof (See also note #5)	18 psf
B. Floor	n/a psf
C. Other	n/a psf
4. Truss Loads:	
A. Top Chord Live	18 psf
B. Top Chord Dead	4 psf
C. Bottom Chord Live	0 psf
D. Bottom Chord Dead	1 psf
5. Snow Loads:	
A. Ground Snow (Pg)	25 psf
B. Flat Roof Snow (Pf)	19.6 psf
C. Snow Exposure Factor (Ce)	0.9
D. Snow Load Importance Factor (I)	0.8
6. Wind Load:	
A. Basic Wind Speed (V)	90 mph
B. Wind Load Importance Factor (I)	0.87
C. Wind Exposure Category	C

STRUCTURAL STEEL

- Hot-rolled structural steel sections shall be designed and constructed according to the "Manual of Steel Construction" by the American Institute of Steel Construction (AISC), and shall conform to the following:
 - Wide flange shapes and WT's: ASTM A992 with a minimum yield strength of 36,000 psi.
 - Angles, plates, bars and miscellaneous connection material: ASTM A36 with a minimum yield strength of 36,000 psi, unless otherwise noted.
 - Steel pipe: ASTM A501 with a minimum yield strength of 36,000 psi.
 - Round Steel Tube: ASTM A500, with a minimum yield strength of 50,000 psi.
 - All steel shall be hot dipped galvanized.
- Cold-formed light-gauge structural steel sections shall be designed and constructed according to the 1996 edition of the "Cold-Formed Steel Design Manual" by the American Iron and Steel Institute (AISI), and shall conform to the following:
 - C-shapes, Z-shapes, hat shapes and angles: ASTM A607 for painted members and ASTM A653 for galvanized members. All sections shall have a minimum yield strength of 50,000 psi.
 - Field cutting to be done by sawing or shearing. Torch cutting of cold-formed members is not acceptable.
- Connections shall be designed and constructed according to AISC, and shall conform to the following:
 - Bolted connections shall be snug-tightened bearing type connections using indicated diameter ASTM A325 grade 5 bolts typical, and ASTM A307 eyebolts for cable connections, unless noted otherwise.
 - Welded connections shall be in strict accordance with the standards of the American Welding Society (AWS), and the AISC. Use E70 series electrodes for all welds.
 - Anchor bolts shall meet ASTM A307 or A36. Use 3/4" diameter bolts with a 3" hook and 1'-0" minimum embedment into concrete or grout-filled masonry (unless otherwise indicated).
 - Expansion bolts: Use expansive anchors of the diameter and length indicated on the drawings as manufactured by Hill Fastening Systems or approved equal. Use Kwik Bolt II anchors in concrete, and use sleeve anchors in brick and CMU. Fill CMU cells at all bolt locations.
 - Connections exposed to weather or high relative humidity shall be hot-dip galvanized per ASTM A153.

Miscellaneous

- Fabric:
 - Roof and wall cover is Nova-Thene RUBX-6 woven coated fabric by Intertape Polymer Group or equal.
 - The fabric is tensioned both vertically and horizontally to prevent wear abrasion, and is secured at bottom w/ tensioning bar and ratchet, and at ends with lacing.
 - Roof fabric shall have a minimum wet tear of 125 lbs. for a 2 inch wide strip.
- Bracing Material:
 - "X" and "Sway" bracing to be 7x19 construction cable with the following nominal breaking strength: 1/2" diameter-7000 lbs. 3/16" diameter-4200 lbs.
- Steel tube frames to be constructed and erected according to We Cover Building Systems standard practices and standard industry guidelines.

This drawing is the property of Timber Tech Engineering, Inc. and reproduction, alteration or use of this drawing without the written consent of Timber Tech Engineering, Inc. is prohibited. Drawings shall not be scaled to obtain dimensions. The contractors and builders involved on this project shall verify all dimensions and conditions before starting work and any discrepancy shall be reported to the engineer in writing before starting work.

IMPORTANT NOTE:
This plan is intended to reflect only the structural design of this building.




CONTRACTOR:
Yoder Way
Emery Yoder
191 Buttonwood Road
Newport, PA 17074
Phone: (717) 535-5883
Fax: (717) 535-4491

DRAWING TITLE:
Framing Elevation
Roof Bracing Plan
Cross Section A/1
Detail A-A/1

PROJECT:
Standard Design of 42'
Steel Arch Frame


REVISIONS:	DATE:	BY:

DRAWING NUMBER: E004-07	
DATE: 1-31-2007	PAGE: 1 of 2
BY: kms	SCALE: as noted

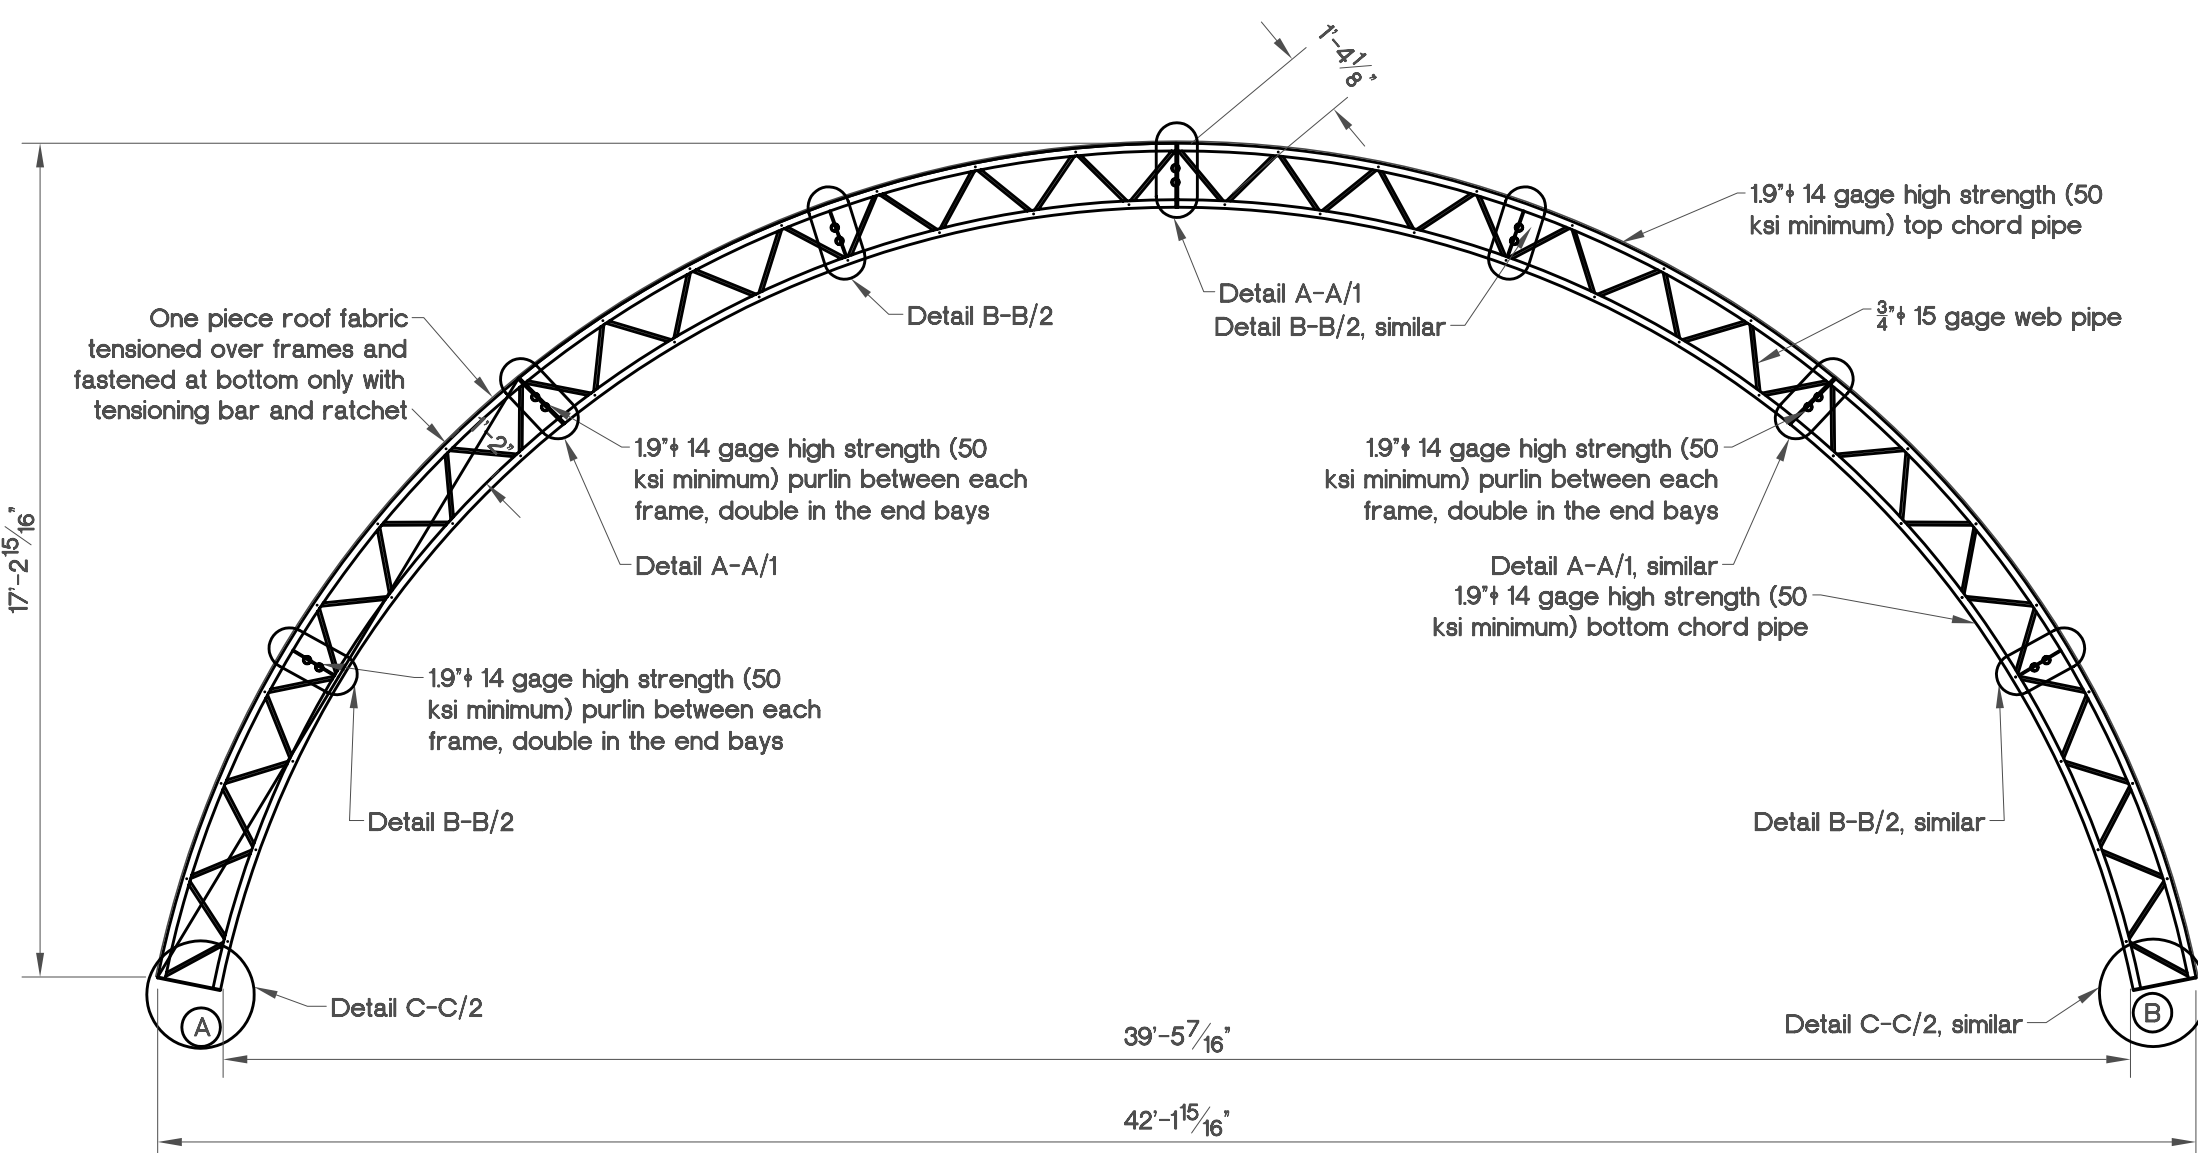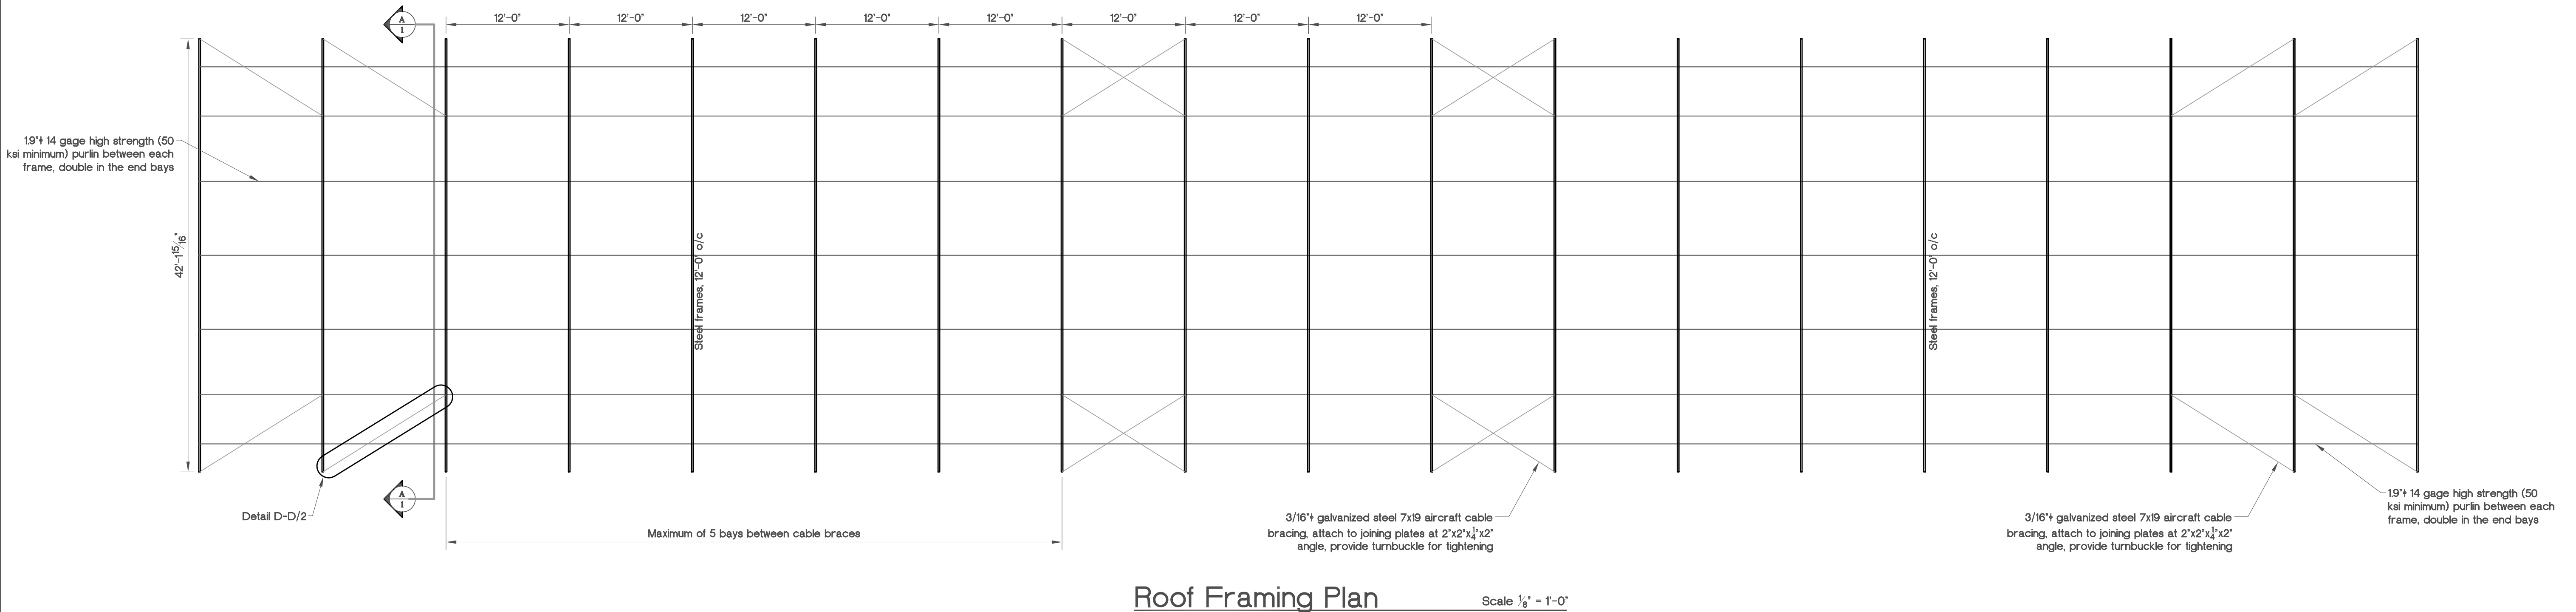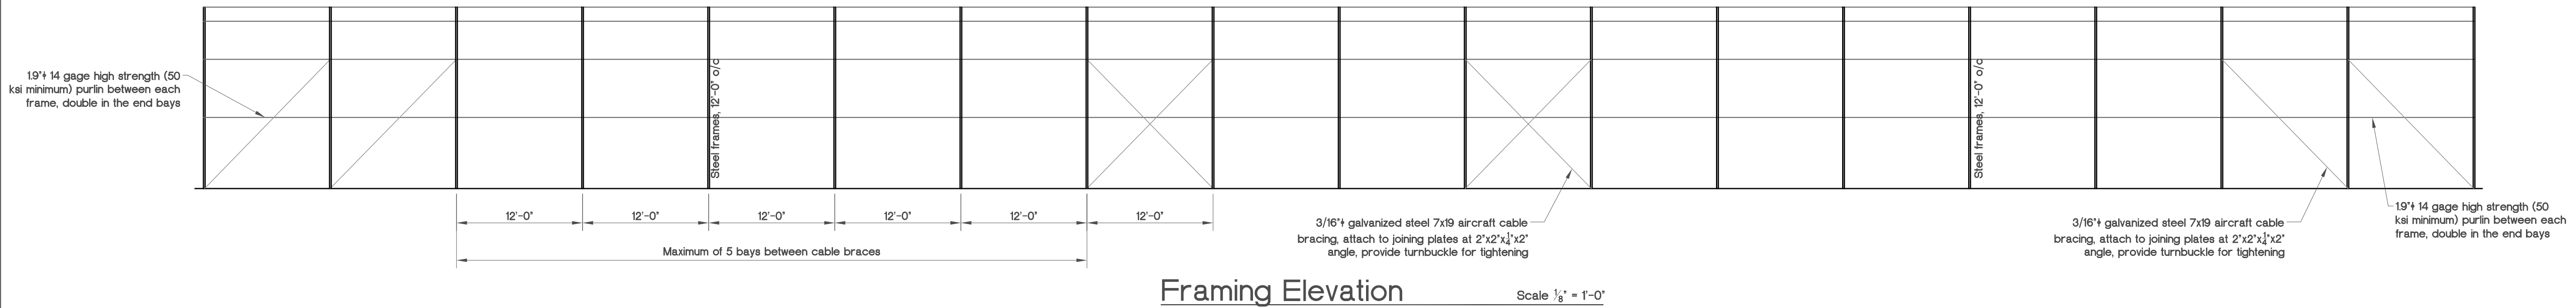



Reactions (lbs.)				
Case	Dead	Snow	Unbal. Snow	Wind*
A Horiz.	550	2750	1300	-3000
A Vert.	900	3400	800	-2000
B Horiz.	-550	-2750	-1300	1100
B Vert.	900	3400	3100	-2950

Horizontal reaction positive acting to right
Vertical reaction positive acting upwards
* Add 4,200 lbs. uplift at cable brace locations

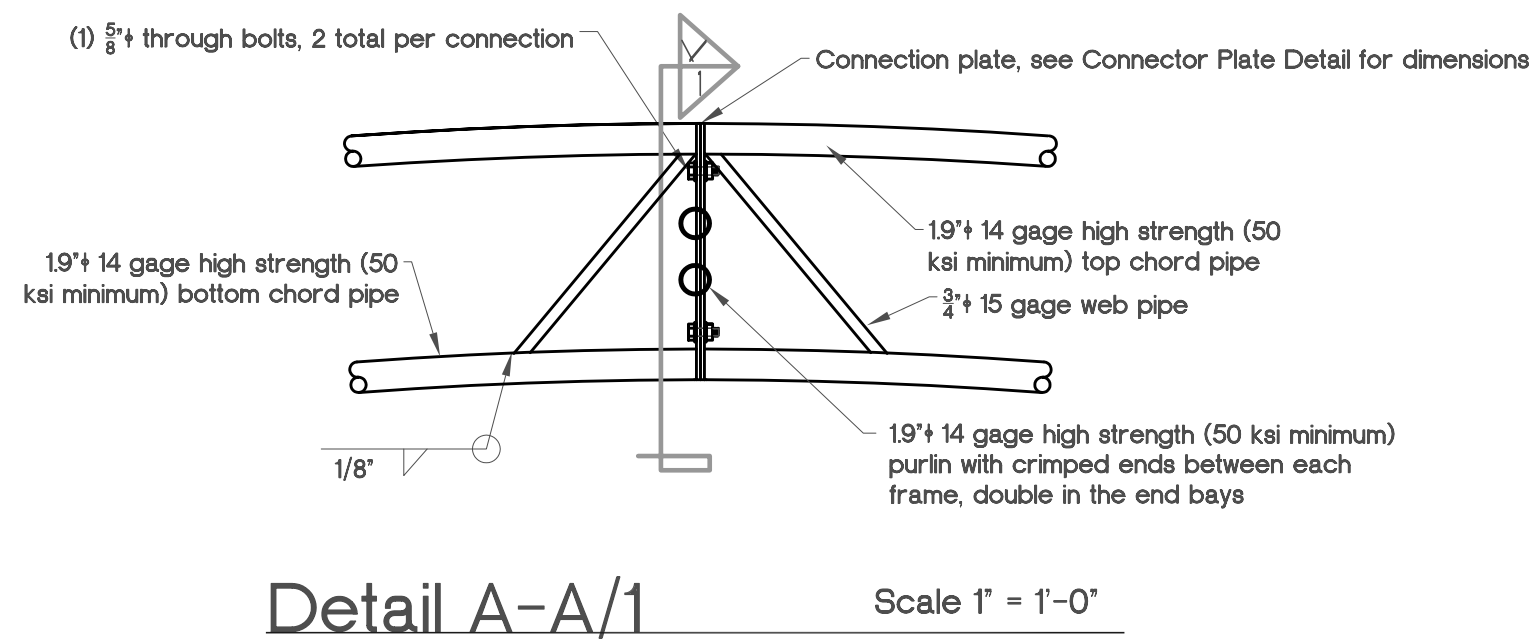


ROOF FRAMING LINE LEGEND	
	TRUSSES
	PURLINS
	CABLE BRACING

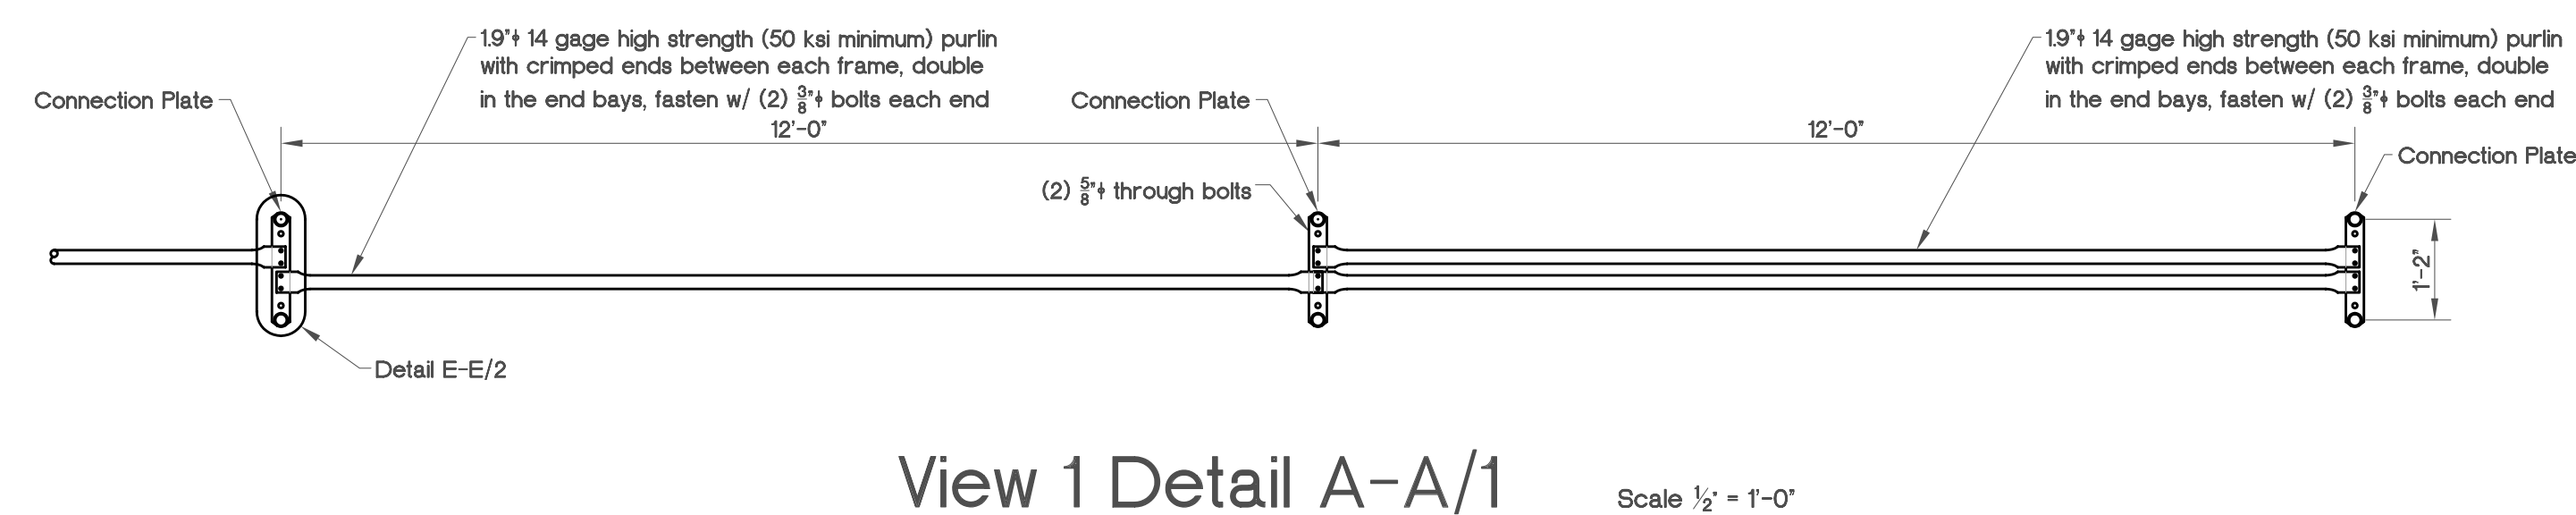


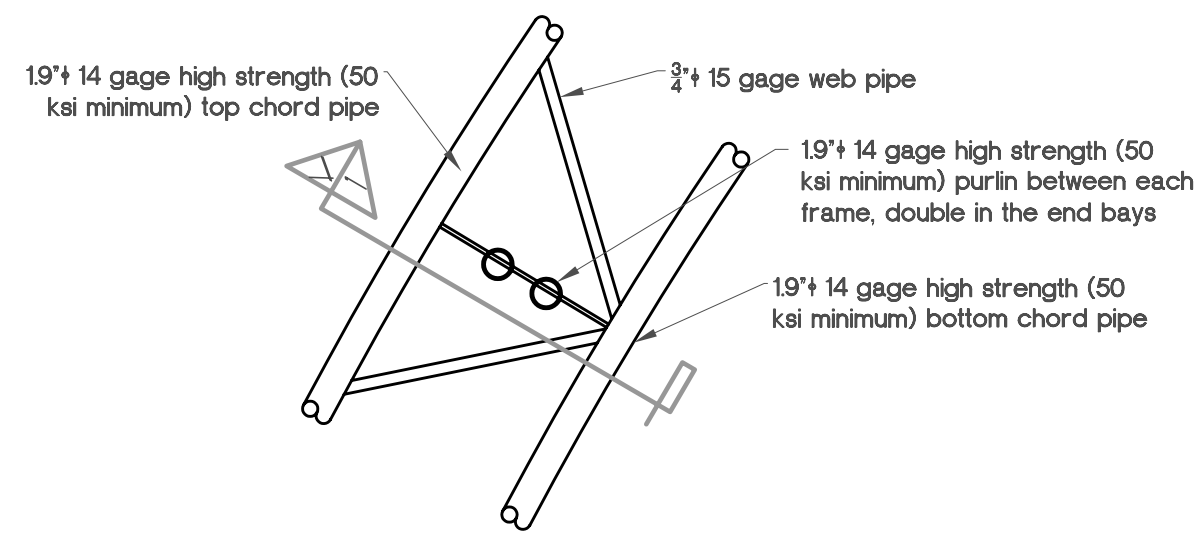


Detail B-B/2 Scale 1" = 1'-0"

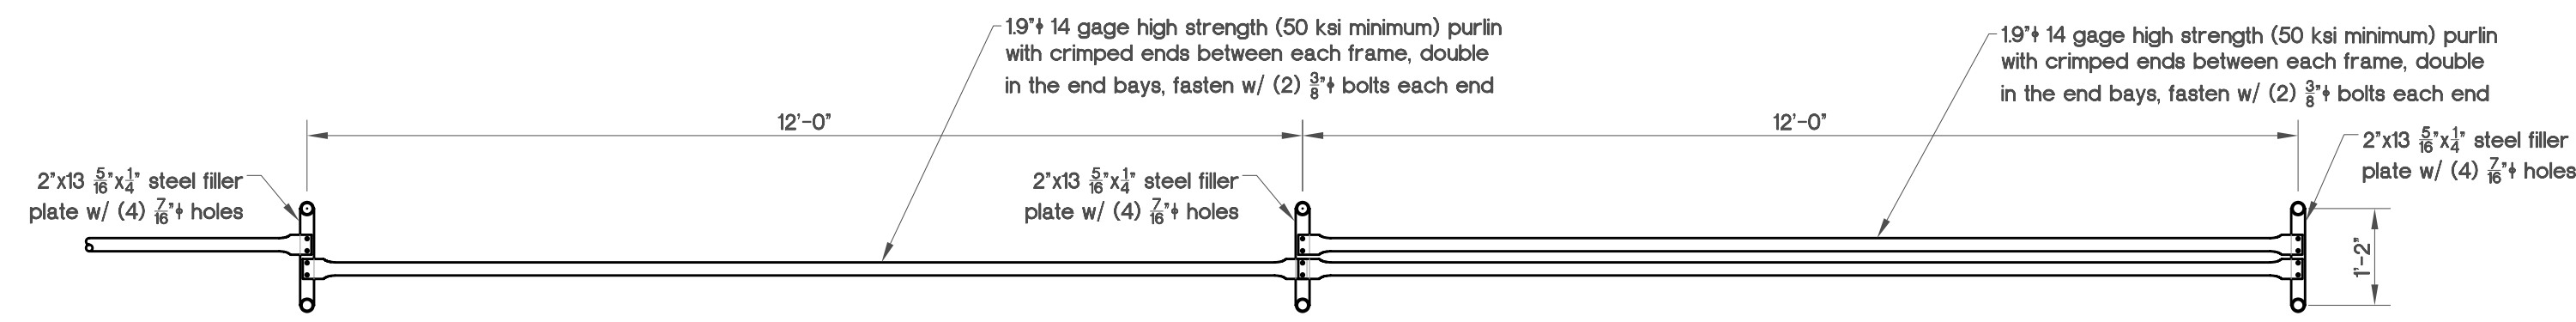


View 1 Detail B-B/2 Scale 1/2" = 1'-0"

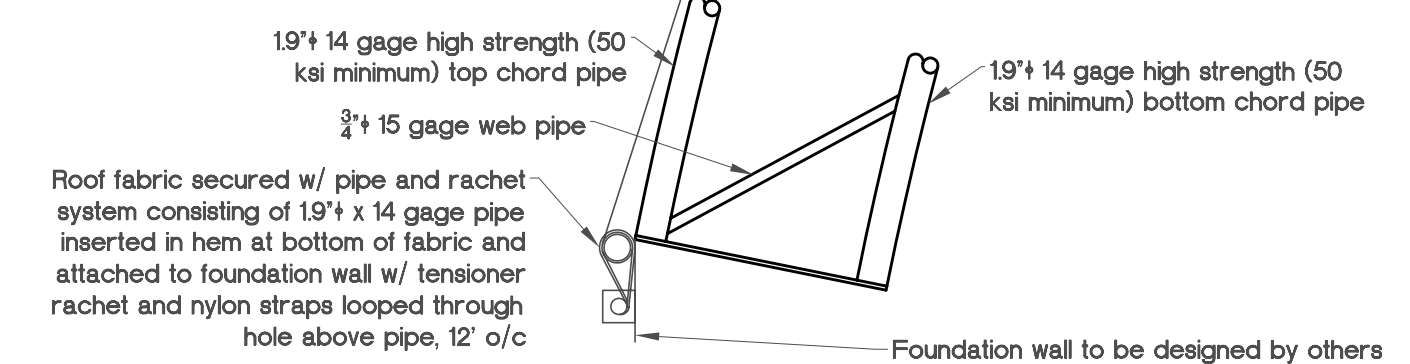


Detail C-C/2 Scale 1" = 1'-0"

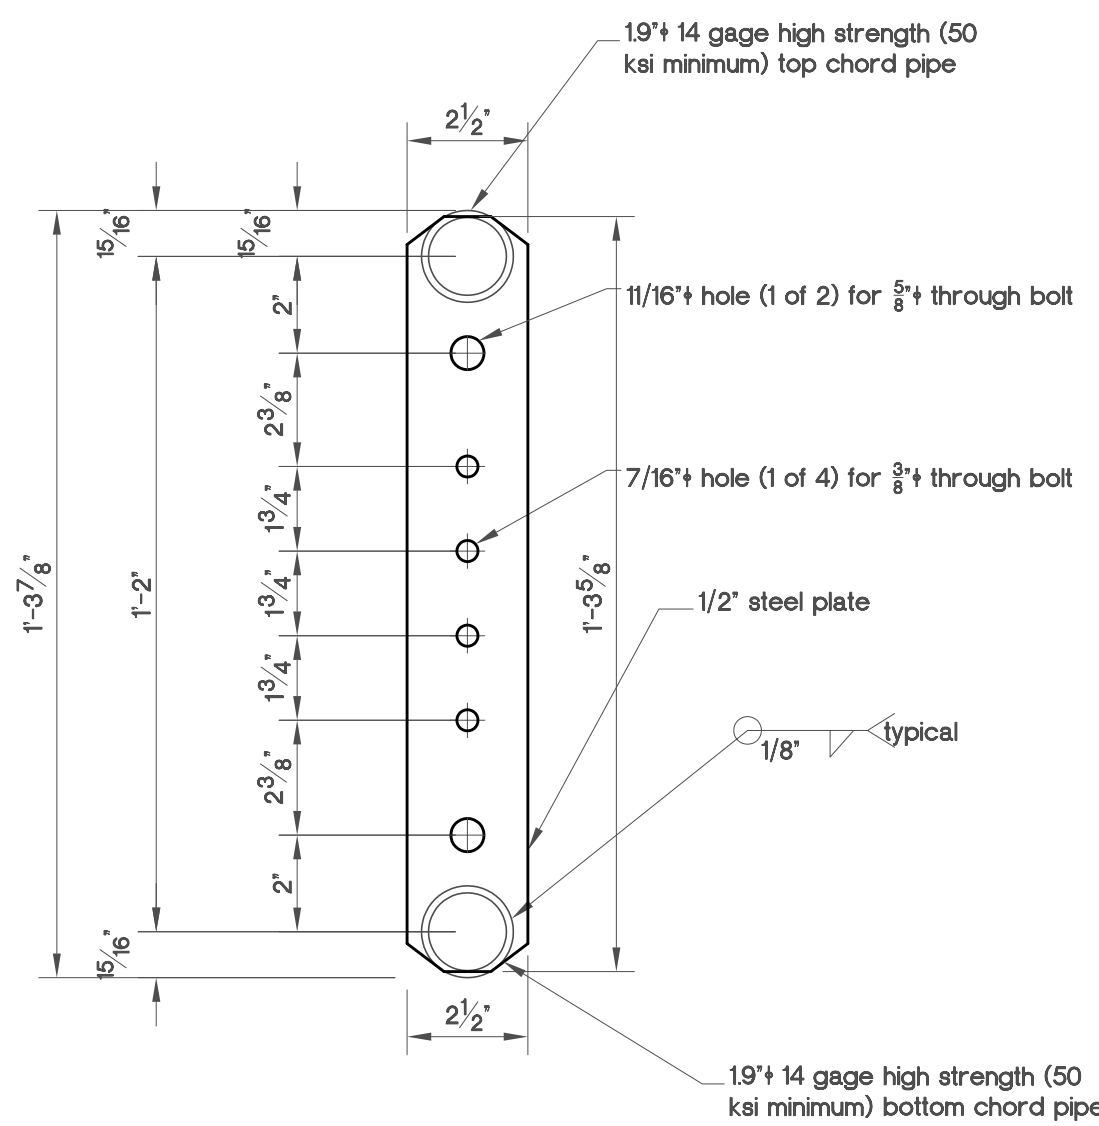


Connector Plate Detail Scale 3" = 1'-0"

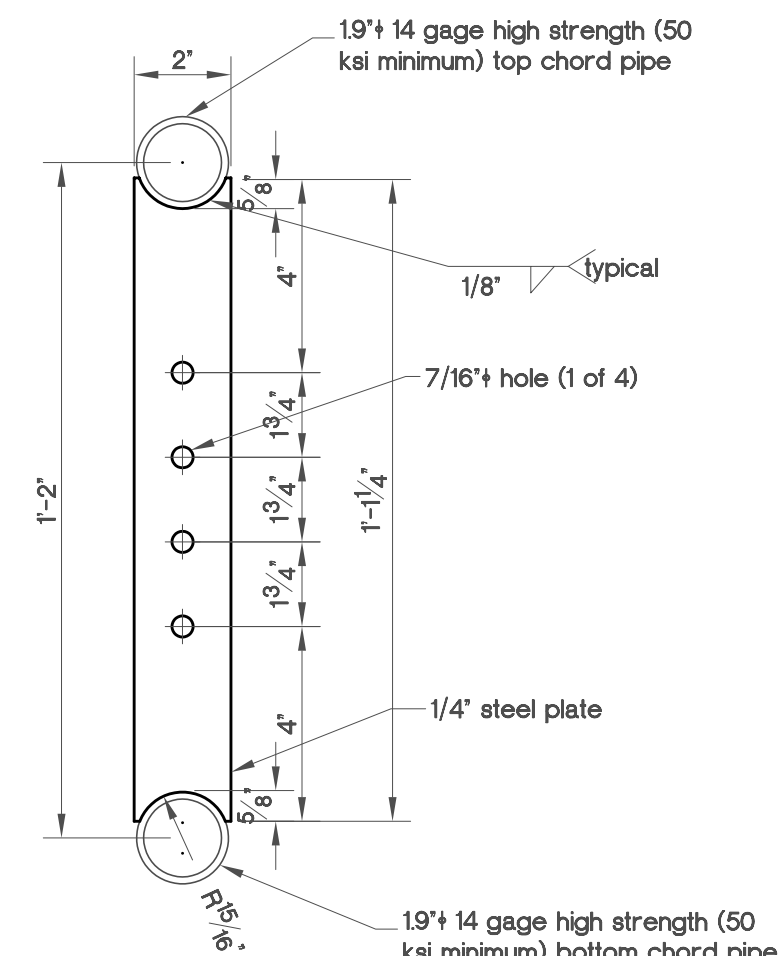


Filler Plate Detail Scale 3" = 1'-0"

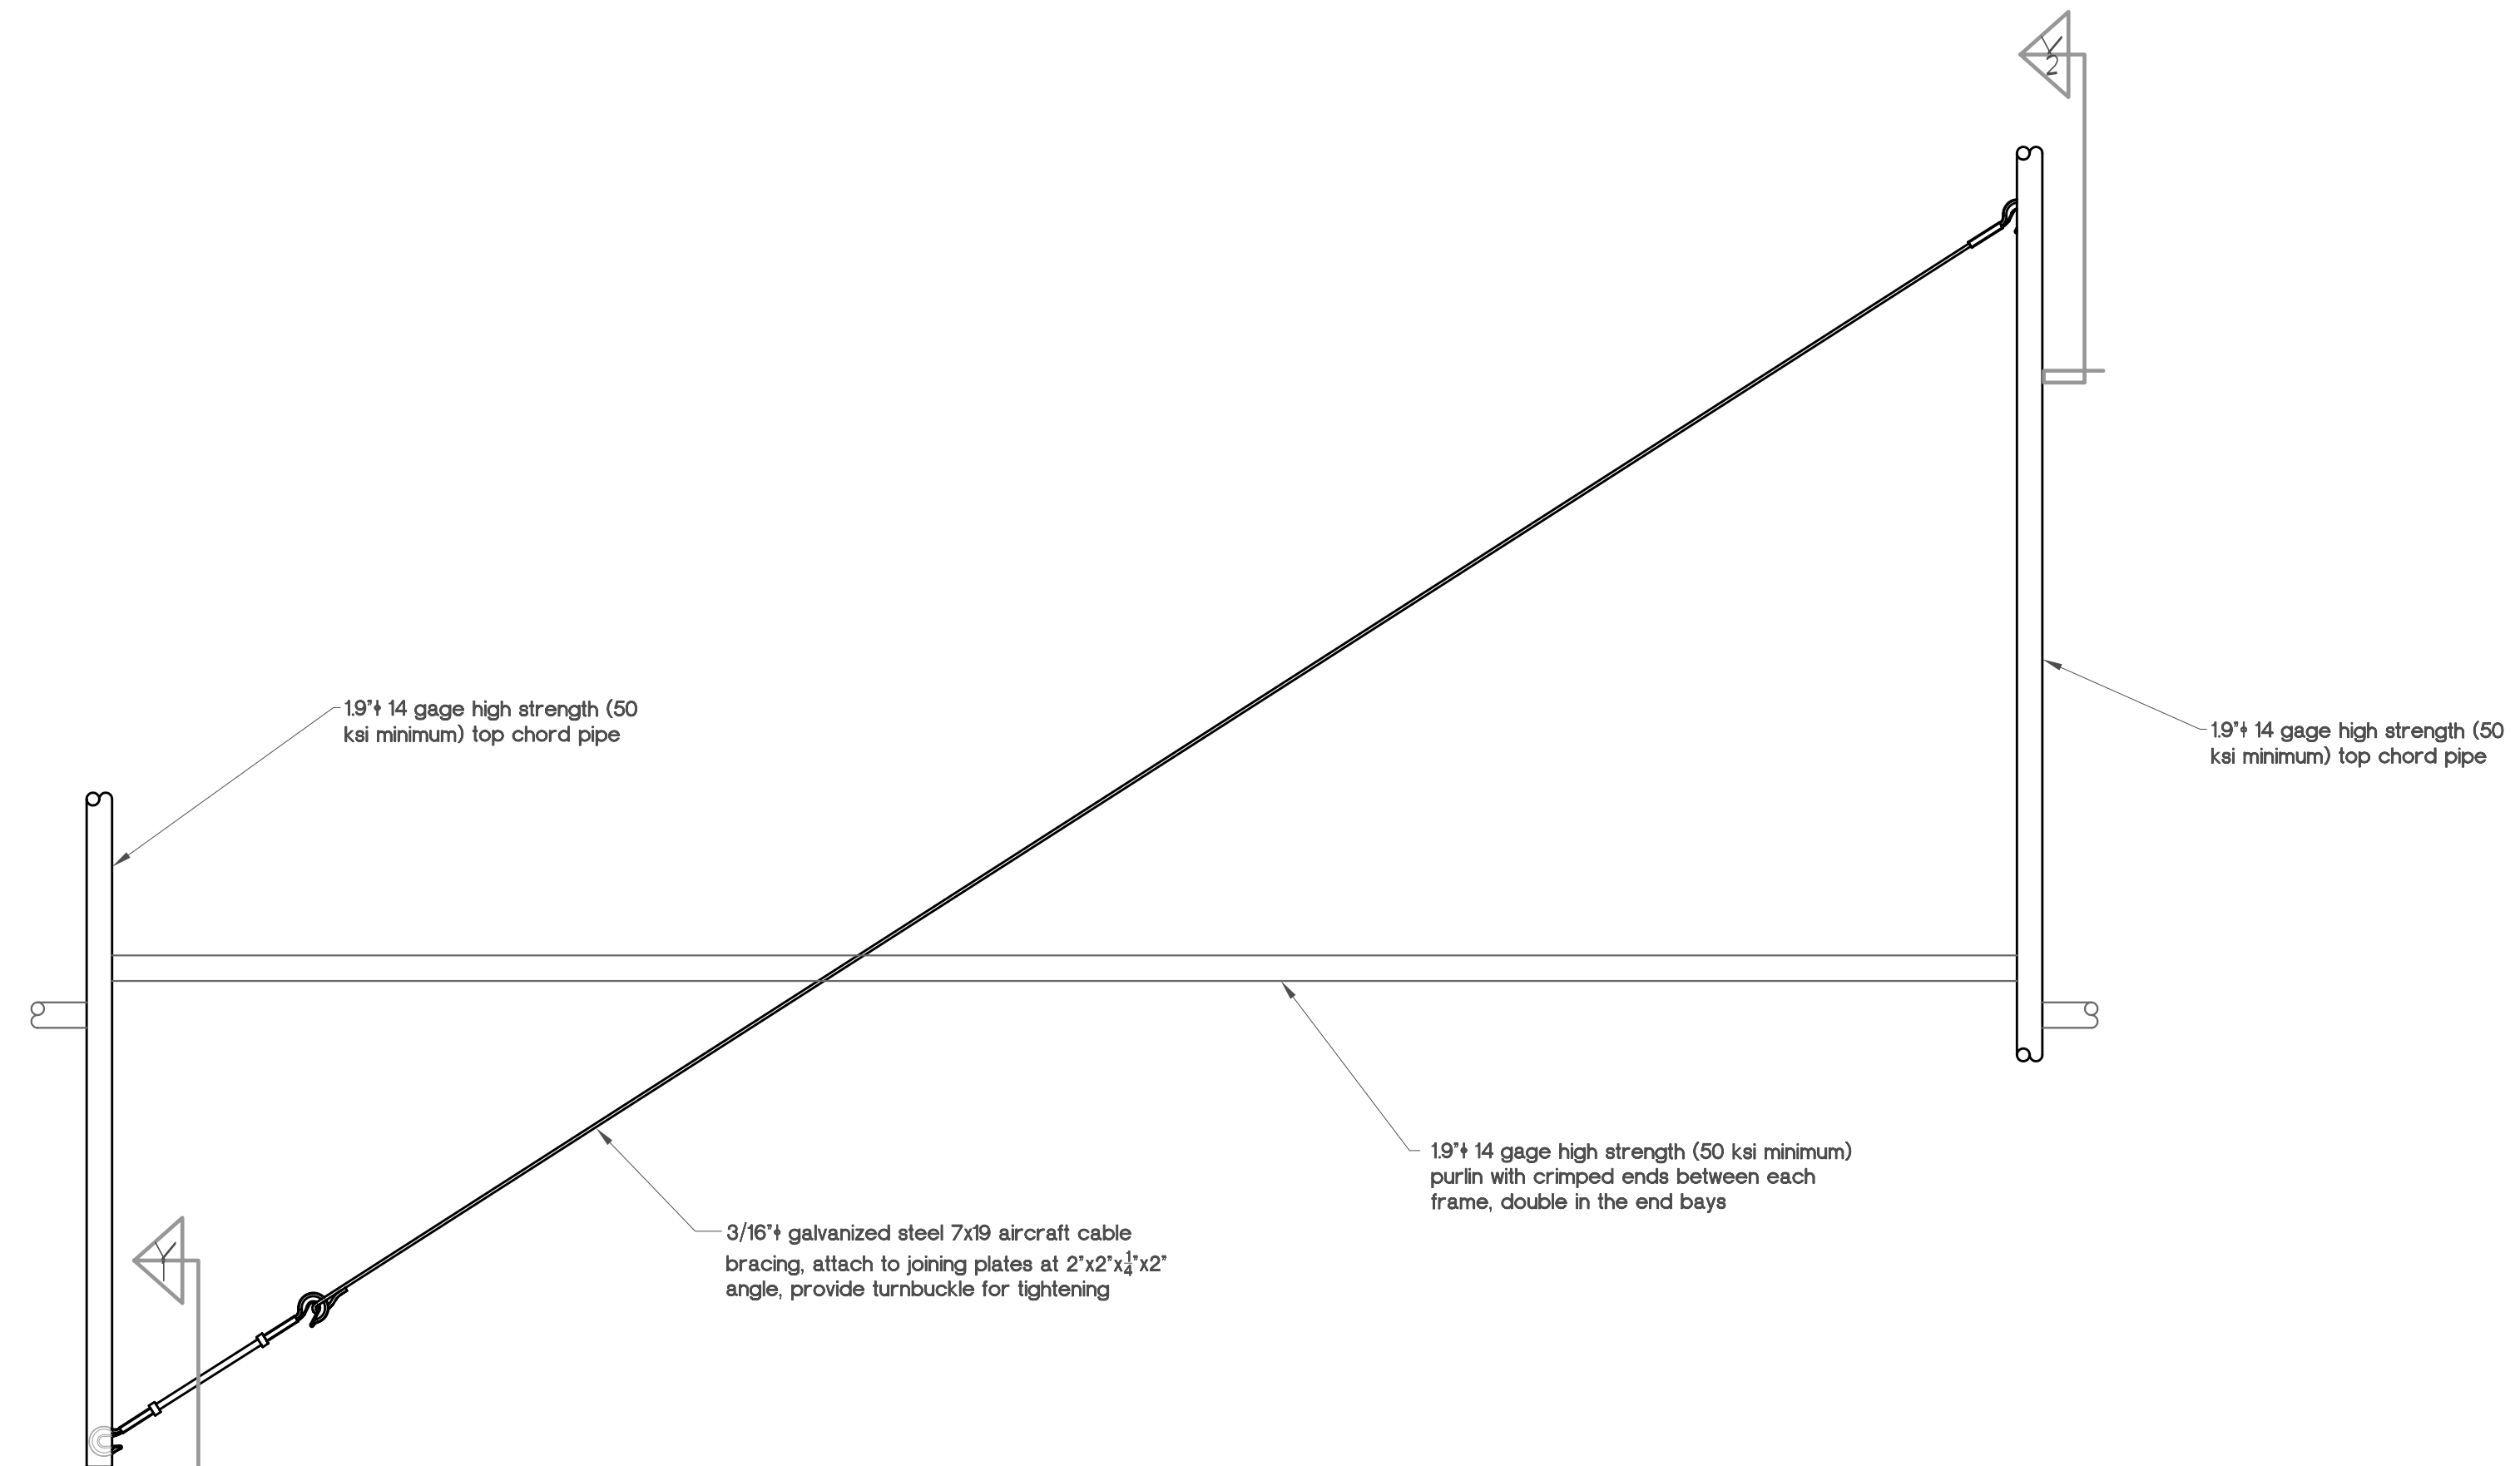


Detail D-D/2 Scale 1" = 1'-0"

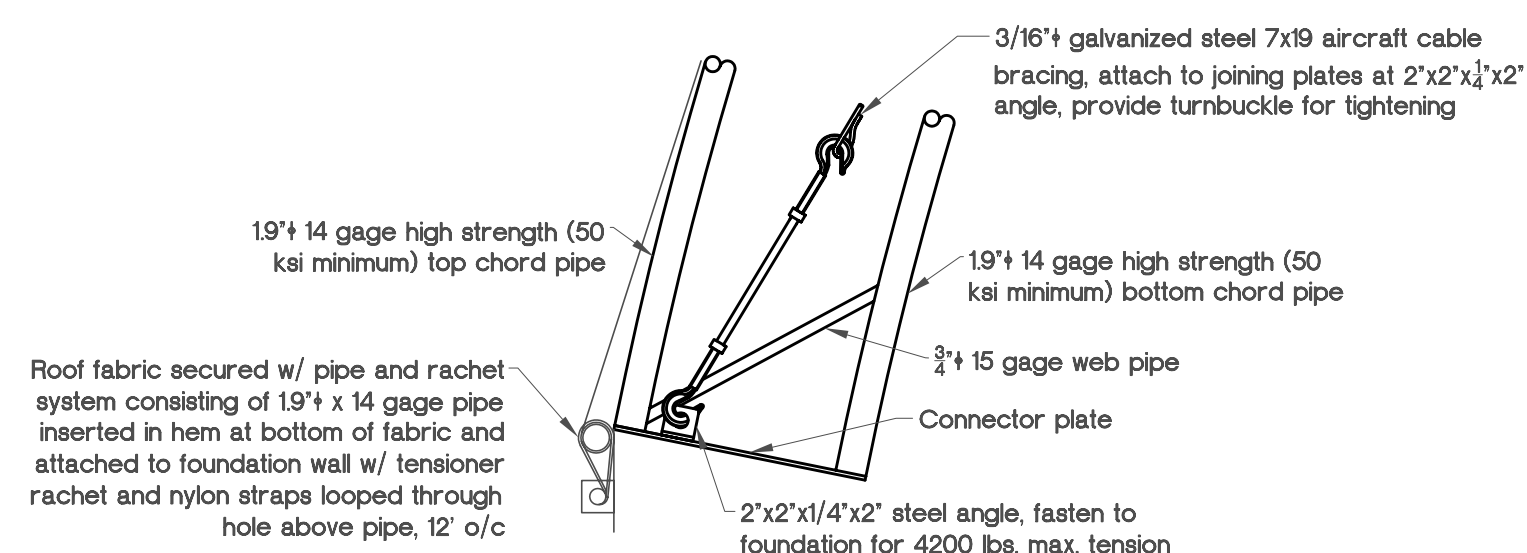


View 1 Detail D-D/2 Scale 1" = 1'-0"

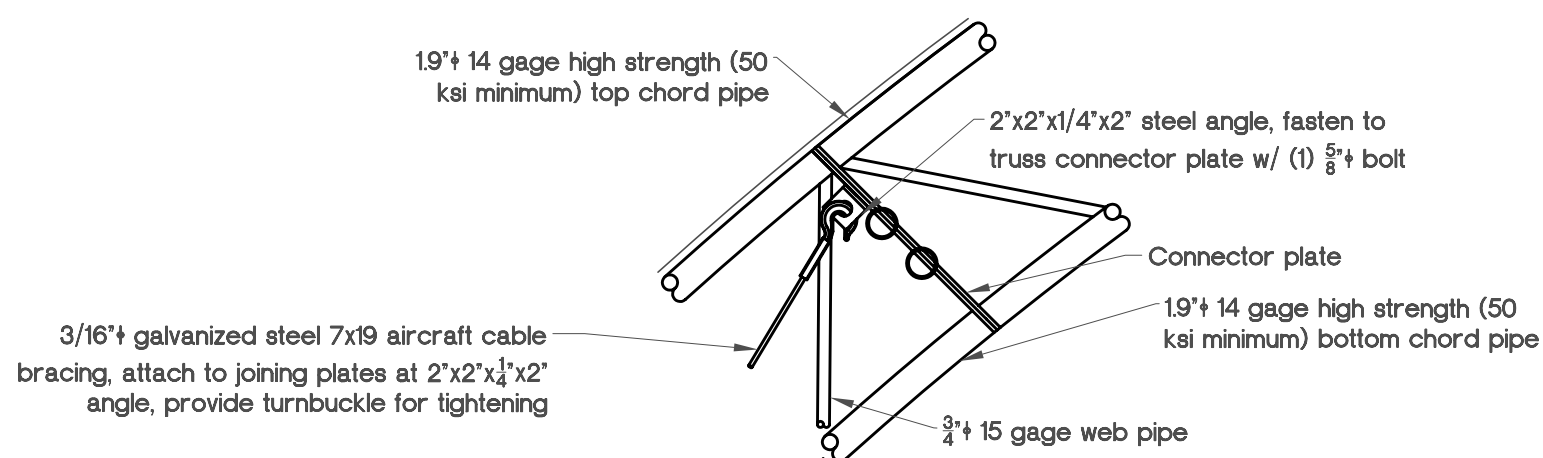

View 2 Detail D-D/2 Scale 1" = 1'-0"

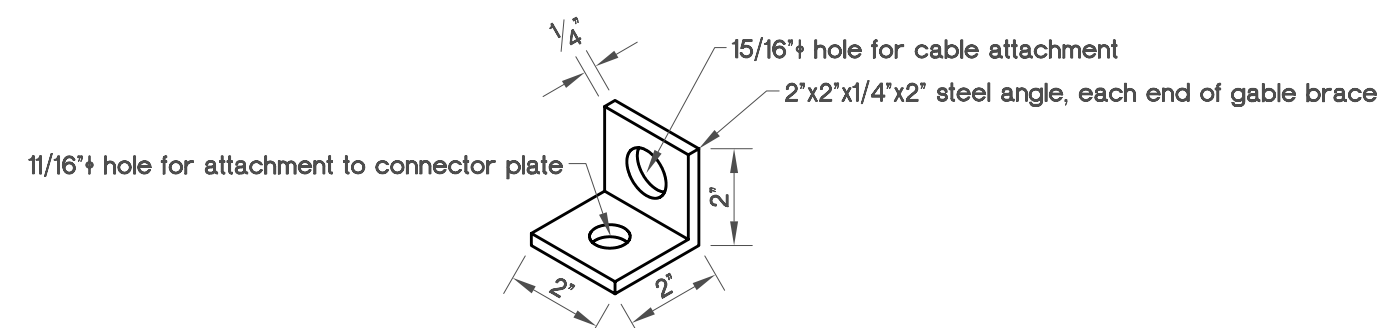

2" x 2" x 1/4" x 2" Steel Angle Scale 3" = 1'-0"

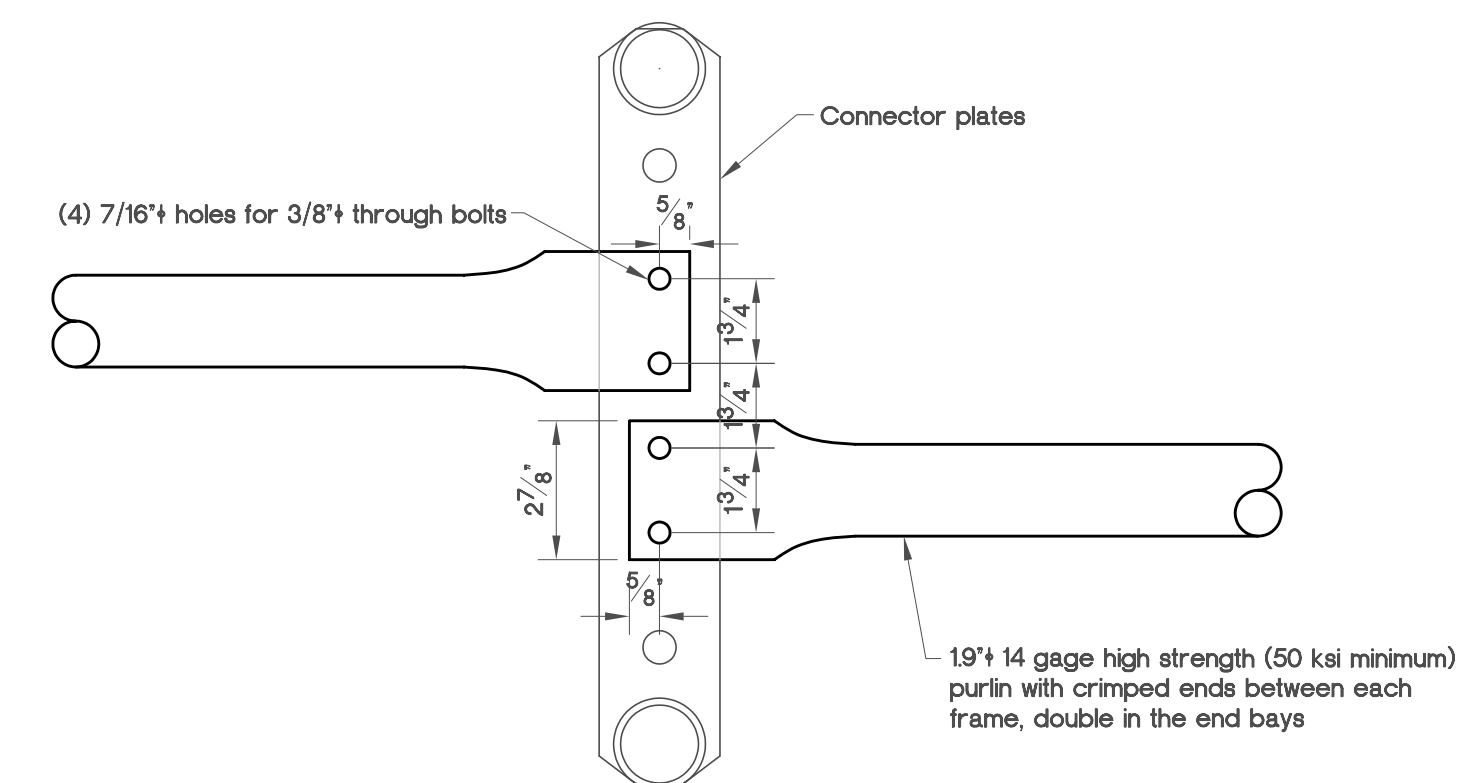

2" x 2" x 1/4" x 2" Steel Angle Scale 3" = 1'-0"

This drawing is the property of Timber Tech Engineering, Inc. and reproduction, alteration or use of this drawing without the written consent of Timber Tech Engineering, Inc. is prohibited. Drawings shall not be scaled to obtain dimensions. The contractors and builders involved on this project shall verify all dimensions and conditions before starting work and any discrepancy shall be reported to the engineer in writing before starting work.

IMPORTANT NOTE:
This plan is intended to reflect only the structural design of this building.

CONTRACTOR:
Yoder Way
Emery Yoder
191 Buttonwood Road
Newport, PA 17074
Phone: (717) 535-5883
Fax: (717) 535-4491

DRAWING TITLE:
Detail B-B/2
Detail C-C/2
Connector Plate Detail
Filler Plate Detail
Detail D-D/2
Detail E-E/2

PROJECT:
Standard Design of 42'
Steel Arch Frame

REVISIONS:	DATE:	BY:

DRAWING NUMBER: E004-07	
DATE: 1-31-2007	PAGE: 2 of 2
BY: kms	SCALE: as noted